



**Phase monitoring relay, over- undervoltage, 2W, 300-500V50/60Hz,  
tv=0.1-30s**

**Part no.** EMR5-W500-1-D  
**Catalog No.** 134221  
**Alternate Catalog No.** EMR5-W500-1-D  
**EL-Nummer (Norway)** 4110381

## Delivery program

|                              |       |      |                                                                                                                                    |
|------------------------------|-------|------|------------------------------------------------------------------------------------------------------------------------------------|
|                              |       |      | This item will continue to be available for a limited time only and is being replaced by the following item: 184779, EMR6-W500-D-1 |
| Product range                |       |      | EMR Measuring and monitoring relays                                                                                                |
| Basic function               |       |      | Phase monitoring relays                                                                                                            |
| Function                     |       |      | On- and Off-delayed                                                                                                                |
|                              |       |      | Power supply from the measuring circuit<br>On-delay/off-delay: none = 0 or adjustable between 0.1 - 30 s                           |
| Monitoring voltage per phase | $U_N$ | V AC | 300 - 500 V AC, 50/60 Hz                                                                                                           |
| Monitoring of                |       |      | Phase sequence<br>Phase failure<br>Overvoltage<br>Undervoltage                                                                     |
| Threshold value              |       |      | $U_{max}$ 420 - 500 V AC<br>$U_{min}$ 300 - 380 V AC                                                                               |
| Adjustable threshold values  |       |      | Overvoltage<br>Undervoltage                                                                                                        |
| Contact sequence             |       |      |                                                                                                                                    |
| Supply voltage               |       |      | 300 - 500 V AC, 50/60 Hz                                                                                                           |
| Width                        |       | mm   | 22.5                                                                                                                               |

## Technical data

### Technical data in sheet catalogue

|                                        |  |  |                         |
|----------------------------------------|--|--|-------------------------|
| Other technical data (sheet catalogue) |  |  | Phase monitoring relays |
|----------------------------------------|--|--|-------------------------|

## Design verification as per IEC/EN 61439

|                                                                                                                        |            |    |                                                                    |
|------------------------------------------------------------------------------------------------------------------------|------------|----|--------------------------------------------------------------------|
| Technical data for design verification                                                                                 |            |    |                                                                    |
| Rated operational current for specified heat dissipation                                                               | $I_n$      | A  | 0                                                                  |
| Heat dissipation per pole, current-dependent                                                                           | $P_{vid}$  | W  | 0                                                                  |
| Equipment heat dissipation, current-dependent                                                                          | $P_{vid}$  | W  | 0                                                                  |
| Static heat dissipation, non-current-dependent                                                                         | $P_{vs}$   | W  | 2                                                                  |
| Heat dissipation capacity                                                                                              | $P_{diss}$ | W  | 0                                                                  |
| Operating ambient temperature min.                                                                                     |            | °C | -25                                                                |
| Operating ambient temperature max.                                                                                     |            | °C | 60                                                                 |
| IEC/EN 61439 design verification                                                                                       |            |    |                                                                    |
| 10.2 Strength of materials and parts                                                                                   |            |    |                                                                    |
| 10.2.2 Corrosion resistance                                                                                            |            |    |                                                                    |
| 10.2.3.1 Verification of thermal stability of enclosures                                                               |            |    | Meets the product standard's requirements.                         |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat                                             |            |    | Meets the product standard's requirements.                         |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |            |    | Meets the product standard's requirements.                         |
| 10.2.4 Resistance to ultra-violet (UV) radiation                                                                       |            |    | Meets the product standard's requirements.                         |
| 10.2.5 Lifting                                                                                                         |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact                                                                                               |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions                                                                                                    |            |    | Meets the product standard's requirements.                         |
| 10.3 Degree of protection of ASSEMBLIES                                                                                |            |    | Does not apply, since the entire switchgear needs to be evaluated. |

|                                                          |  |  |                                                                                                                                  |
|----------------------------------------------------------|--|--|----------------------------------------------------------------------------------------------------------------------------------|
| 10.4 Clearances and creepage distances                   |  |  | Meets the product standard's requirements.                                                                                       |
| 10.5 Protection against electric shock                   |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.6 Incorporation of switching devices and components   |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.7 Internal electrical circuits and connections        |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.8 Connections for external conductors                 |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.9 Insulation properties                               |  |  |                                                                                                                                  |
| 10.9.2 Power-frequency electric strength                 |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.9.3 Impulse withstand voltage                         |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.9.4 Testing of enclosures made of insulating material |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.10 Temperature rise                                   |  |  | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating                               |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility                      |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function                                |  |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |


## Technical data ETIM 6.0

|                                                                                                                                                                                                                           |  |    |                  |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|----|------------------|
| Relays (EG000019) / Phase monitoring relay (EC001441)                                                                                                                                                                     |  |    |                  |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Monitoring equipment (low-voltage switch technology) / Asymmetry monitoring equipment (ecl@ss8.1-27-37-18-03 [AKF097011]) |  |    |                  |
| Type of electric connection                                                                                                                                                                                               |  |    | Screw connection |
| With detachable clamps                                                                                                                                                                                                    |  |    | No               |
| Rated control supply voltage Us at AC 50HZ                                                                                                                                                                                |  | V  | 300 - 500        |
| Rated control supply voltage Us at AC 60HZ                                                                                                                                                                                |  | V  | 300 - 500        |
| Rated control supply voltage Us at DC                                                                                                                                                                                     |  | V  | 0 - 0            |
| Voltage type for actuating                                                                                                                                                                                                |  |    | AC               |
| Phase sequence monitoring                                                                                                                                                                                                 |  |    | Yes              |
| Phase failure monitoring                                                                                                                                                                                                  |  |    | Yes              |
| Function under voltage detection                                                                                                                                                                                          |  |    | Yes              |
| Function over voltage detection                                                                                                                                                                                           |  |    | Yes              |
| Phase imbalance monitoring                                                                                                                                                                                                |  |    | No               |
| Voltage measurement range                                                                                                                                                                                                 |  | V  | 300 - 500        |
| Min. adjustable delay-on energization time                                                                                                                                                                                |  | s  | 0.1              |
| Max. permitted delay-on energization time                                                                                                                                                                                 |  | s  | 30               |
| Min. adjustable off-delay time                                                                                                                                                                                            |  | s  | 0.1              |
| Max. permitted off-delay time                                                                                                                                                                                             |  | s  | 30               |
| Number of contacts as normally closed contact                                                                                                                                                                             |  |    | 0                |
| Number of contacts as normally open contact                                                                                                                                                                               |  |    | 0                |
| Number of contacts as change-over contact                                                                                                                                                                                 |  |    | 0                |
| Width                                                                                                                                                                                                                     |  | mm | 22.5             |
| Height                                                                                                                                                                                                                    |  | mm | 78               |
| Depth                                                                                                                                                                                                                     |  | mm | 100              |


## Approvals

|                             |  |  |                                                   |
|-----------------------------|--|--|---------------------------------------------------|
| Product Standards           |  |  | IEC 255-6; UL 508; CSA-22.2 No. 14-05; CE marking |
| UL File No.                 |  |  | E29184                                            |
| UL Category Control No.     |  |  | NKCR, NKCR7                                       |
| CSA File No.                |  |  | UL report valid                                   |
| CSA Class No.               |  |  | 3211-03                                           |
| North America Certification |  |  | UL listed, certified by UL for use in Canada      |
| Degree of Protection        |  |  | IEC: IP20, UL/CSA Type: -                         |


Characteristics

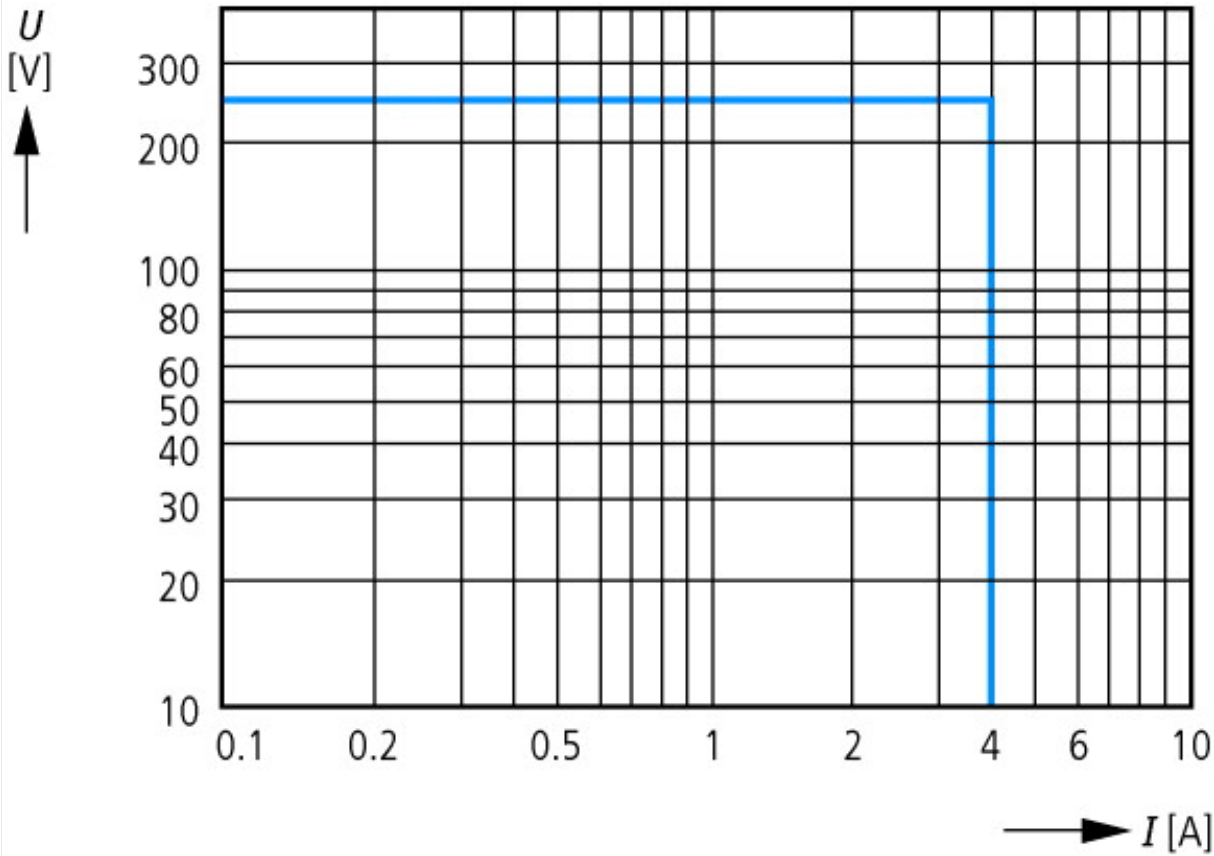


AC load (resistive)

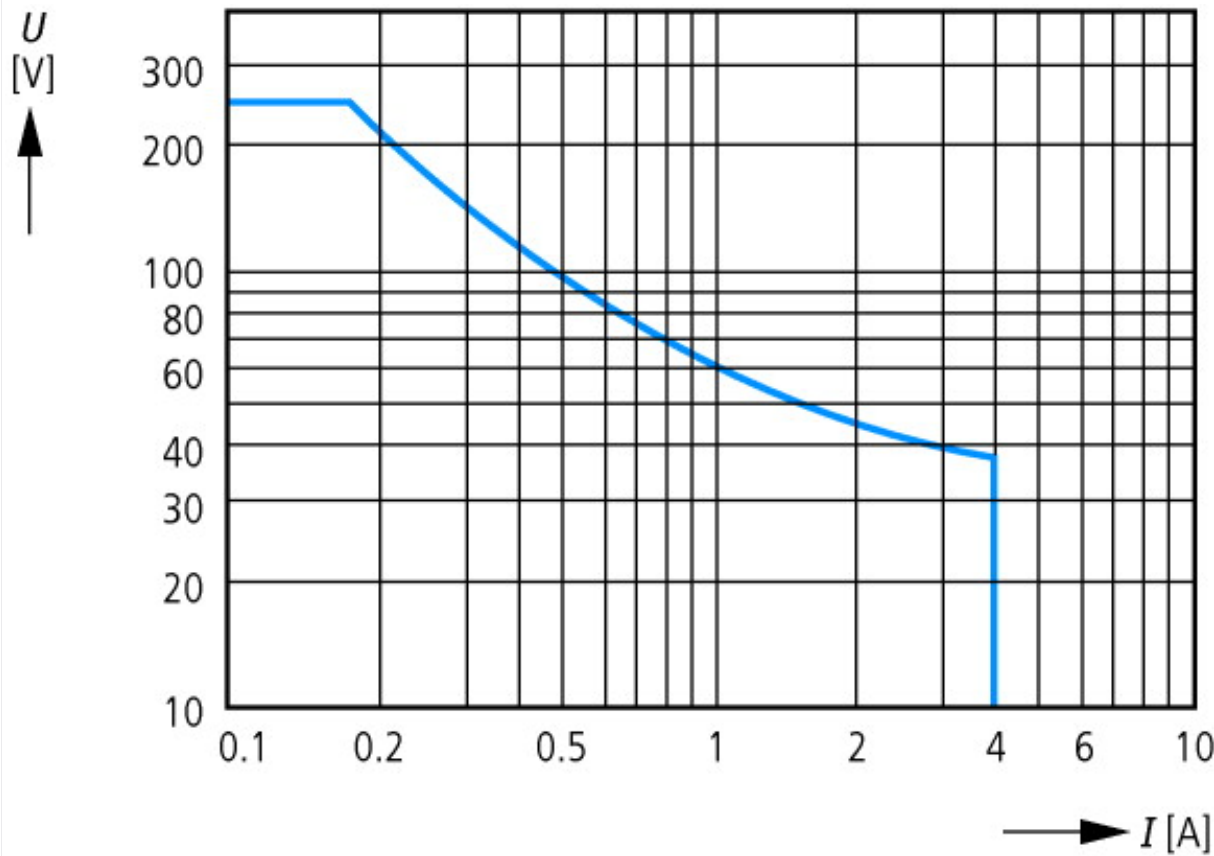

DC load (resistive)

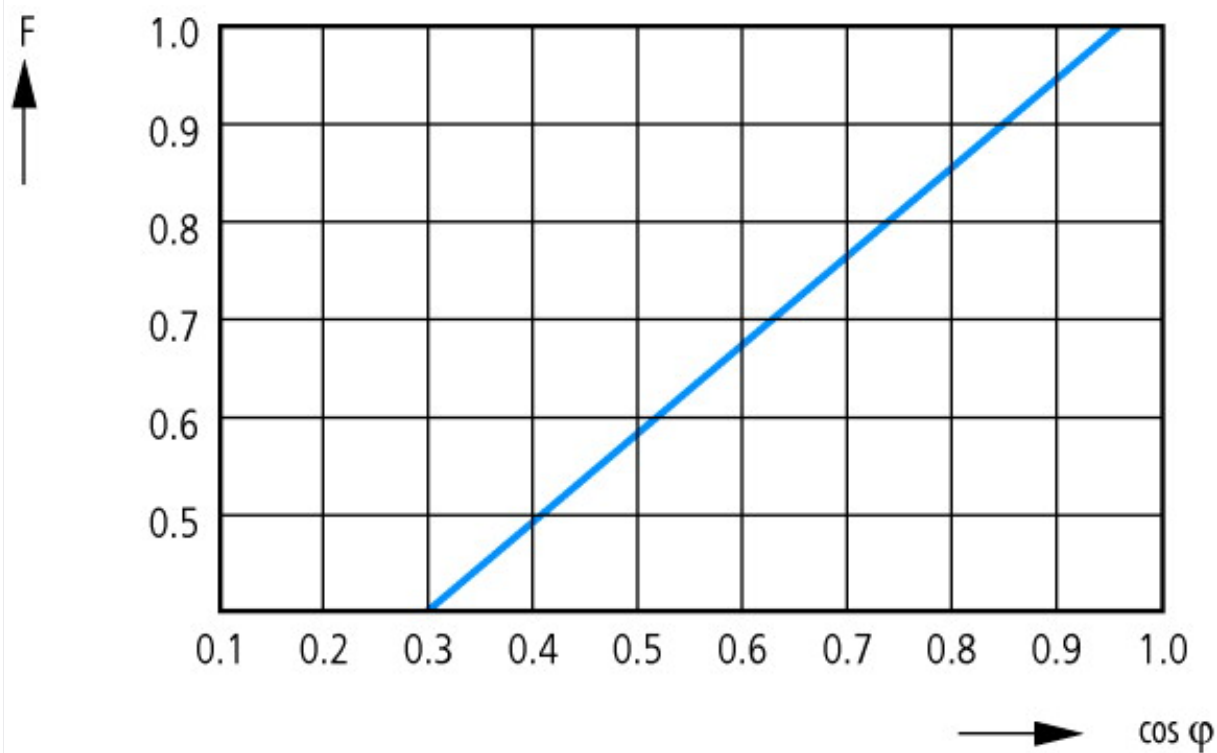


Derating factor  $F$  with inductive AC load

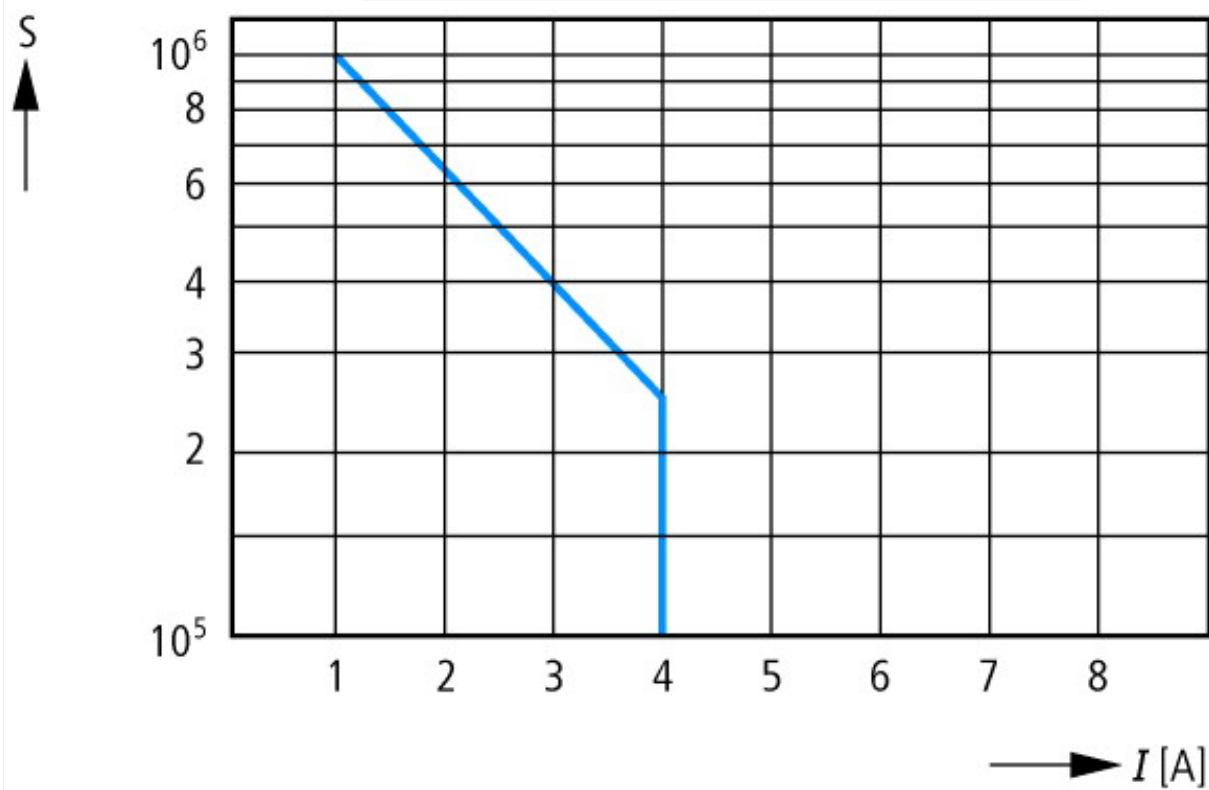

Contact life  
 $S$  operations  
 220 V 50 Hz AC-1  
 360 operations/h

Dimensions

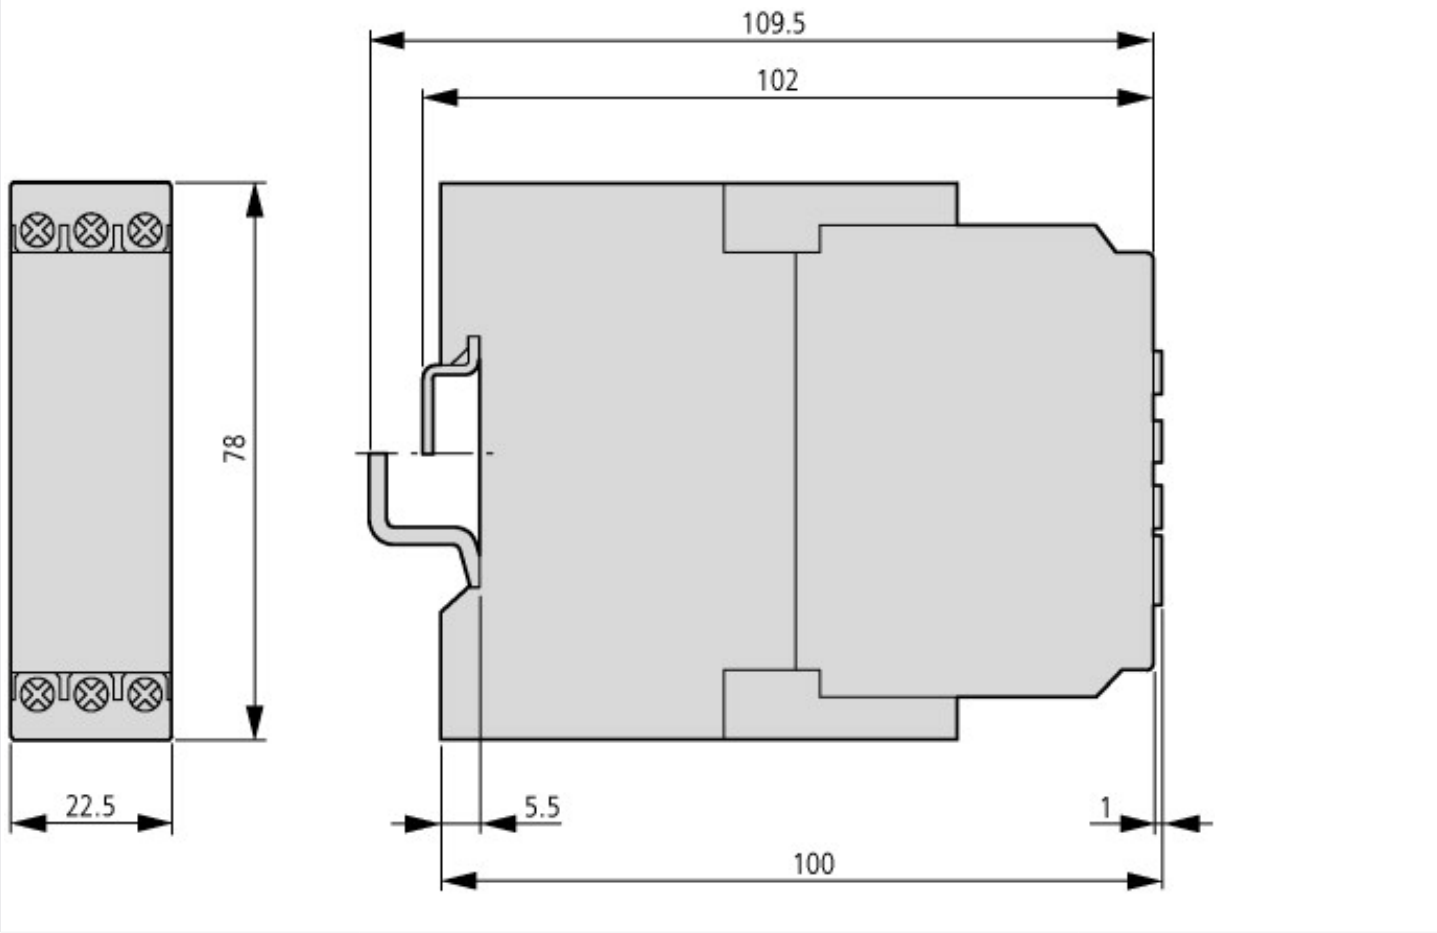

Additional product information (links)

|                                                                           |                                                                                                                                                                                     |
|---------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| IIL04914003Z (AWA2431-2694) Single-function three-phase monitoring relays |                                                                                                                                                                                     |
| IIL04914003Z (AWA2431-2694) Single-function three-phase monitoring relays | <a href="https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IIL04914003Z2018_07.pdf">https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IIL04914003Z2018_07.pdf</a> |
| Phase monitoring relays                                                   | <a href="http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=11.37">http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=11.37</a>                               |